

COMIS 20 FLEX


ΙΟΥΝ 2021


οδηγίες τοποθέτησης


εσωτερικού χώρου / κρεμαστά φωτιστικά

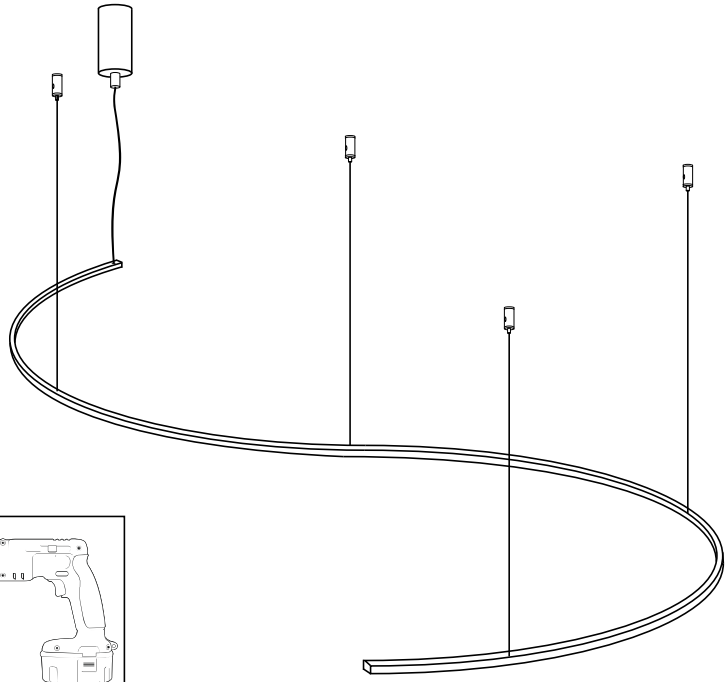










220-230V

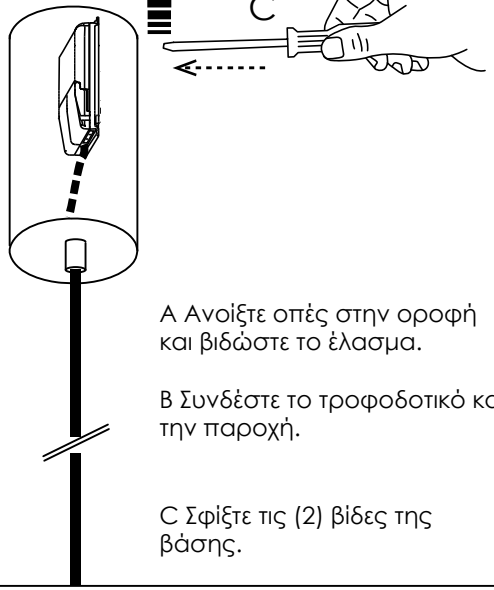


Α Ανοίξτε οπές στην οροφή και βιδώστε το έλασμα.


Β Συνδέστε το τροφοδοτικό και την παροχή.

C Σφίξτε τις (2) βίδες της βάσης.

2 Σύστημα ανάρτησης

Ρυθμίστε το μήκος του συρματόσχοινου.

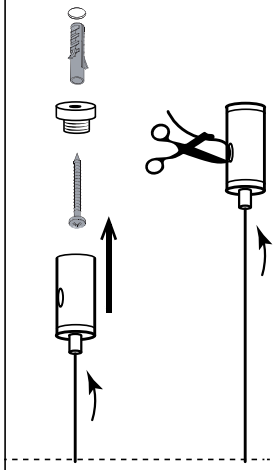





ΟΔΗΓΙΕΣ ΕΓΚΑΤΑΣΤΑΣΗΣ

- Η εγκατάσταση πρέπει να γίνεται από αδειούχο ηλεκτρολόγο.
- Εφόσον υπάρχει ακροδέκτης γείωσης, συνδέστε τον στη γείωση της εγκατάστασης.
- Βεβαιωθείτε ότι η παροχή είναι απενεργοποιημένη κατά τη συντήρηση.
- Μετά την εγκατάσταση ελέγξτε τη στερέωση και τη σύσφιξη των στυπιοθλιπτών, όπου υπάρχουν.
- Ο κατασκευαστής δεν ευθύνεται για τραυματισμούς ή ζημιές από λανθασμένη εγκατάσταση ή χρήση.
- Δεν προορίζεται για βρογχοειδή σύνδεση.
- Τα ούπα και οι κλέμες δεν περιλαμβάνονται.
- Τα στοιχεία LED αντικαθίστανται μόνο από τον κατασκευαστή.

ΠΡΟΣΟΧΗ
Φοράτε αντιστατικά γάντια όταν αγγίζετε τα LED.

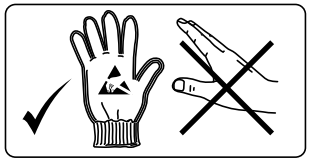

ΠΡΟΣΟΧΗ
Αντικαταστήστε τυχόν ραγισμένο γυαλί.



BRIGHT
ΕΙΔΙΚΟΣ ΦΩΤΙΣΜΟΣ

www.bright.gr

Εργοστάσιο: Κεφαλοβρύσου 5, Μονομάτι, Αχαρνές, Τ.Κ. 13677, Αθήνα, Ελλάδα Τηλ: (+30) 210 6208 230 Fax: (+30) 210 62 08 262 E-mail: info@bright.gr

IP40/ IP65


GREENLIGHT


COMIS 20 FLEX


JUNE 2021


installation instructions


indoor/ suspended lights

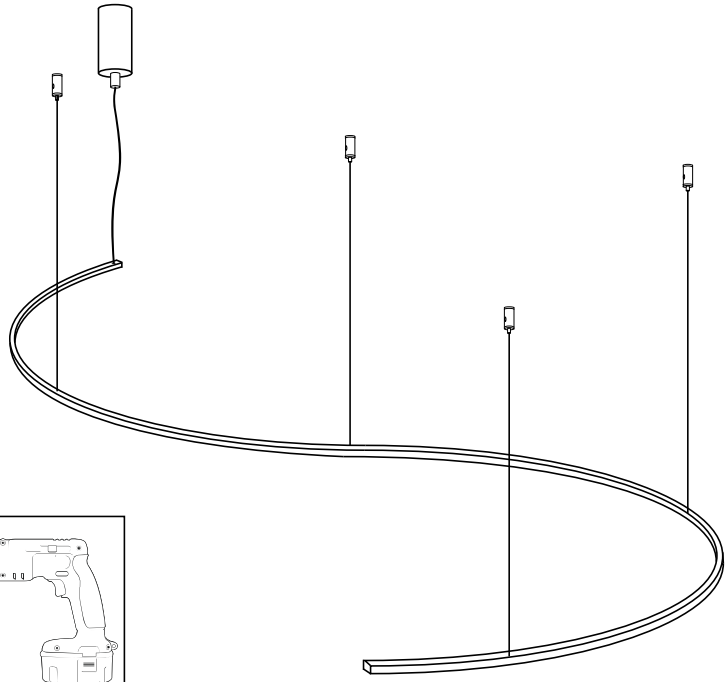




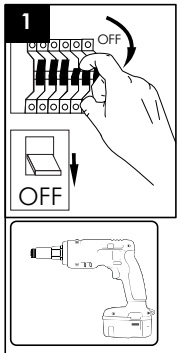





220-230V

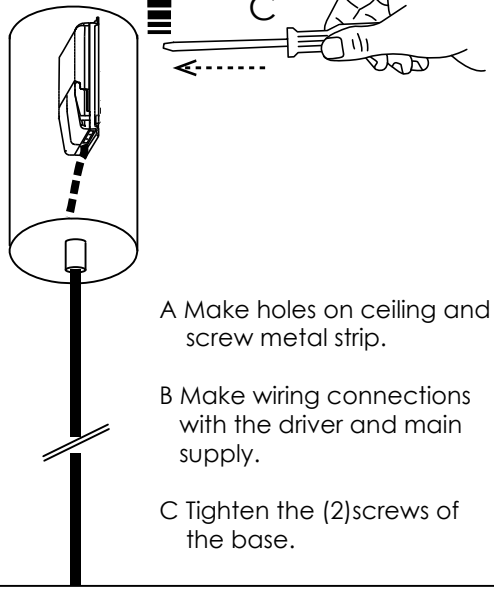


A Make holes on ceiling and screw metal strip.


B Make wiring connections with the driver and main supply.

C Tighten the (2)screws of the base.

2 **Suspension system**

Adjust the length of the wire.

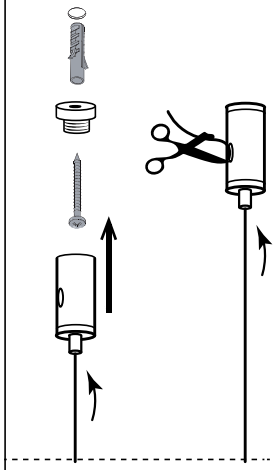





USER INSTRUCTIONS

- The installation of the unit must be done by a qualified electrician.
- The unit must be earthed in case an earth connecting point exists.
- Ensure that the mains is switched off during servicing.
- Ensure that after the installation, the unit is properly fixed and the cable clamps (if exist) are well tightened.
- Manufacturer will not accept liability for injury or damage resulting from incorrect use or installation
- The unit is not intended to operate in loop connection.
- Wall plugs and terminals are not included.
- LED modules are replaced only by the manufacturer.

CAUTION
Wear anti-static gloves
before you touch LED systems

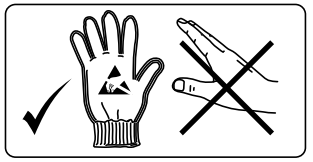

CAUTION
Replace any cracked shield



BRIGHT SPECIAL LIGHTING

www.bright.gr

Factory: 5 Kefalovrisou Str., Monomati, Acharnai, P.O. Box 13677, Athens, Greece
Tel: (+30) 210 6208 230 Fax: (+30) 210 62 08 262 E-mail: info@bright.gr

IP40/ IP65

GREENLIGHT