
ΙΟΥΛ 2024

MINI TERES 1 GROUND BRASS H.P.LED

οδηγίες τοποθέτησης


εξωτερικού χώρου / εδάφους

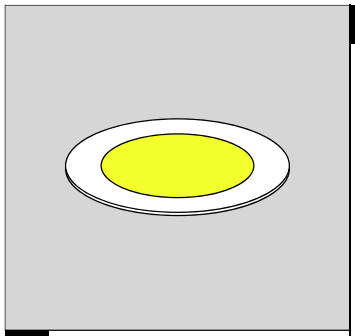

1 **Εγκατάσταση**
Ξεβιδώστε και αφαιρέστε τη βάση.




2 Περάστε το καλώδιο από τον στυπιοθλίπτη. Κάντε τις ηλεκτρικές συνδέσεις.






! Προσοχή
Μην αφαιρείτε το λάστιχο του στυπιοθλίπτη.

Στυπιοθλίπτης με μεμβράνη εξαερισμού



κλειδί No 17

3 Βιδώστε τη βάση και εισάγετε το φωτιστικό στο έδαφος.

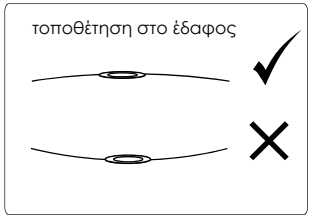





4 **Αντικατάσταση λαμπτήρα**
Ξεβιδώστε και αφαιρέστε το καπάκι του φωτιστικού.



5 Αφαιρέστε το ελατήριο συγκράτησης.

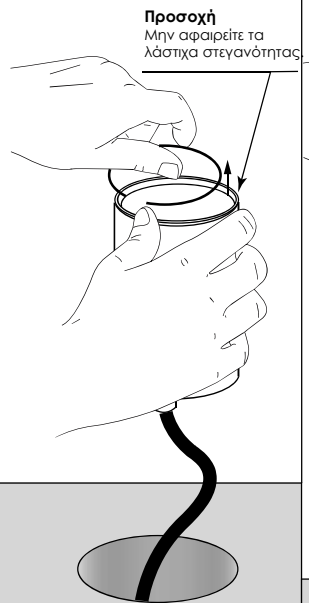

6 Τοποθετήστε τον λαμπτήρα και το ελατήριο. Βιδώστε το καπάκι και εισάγετε το φωτιστικό στο έδαφος.

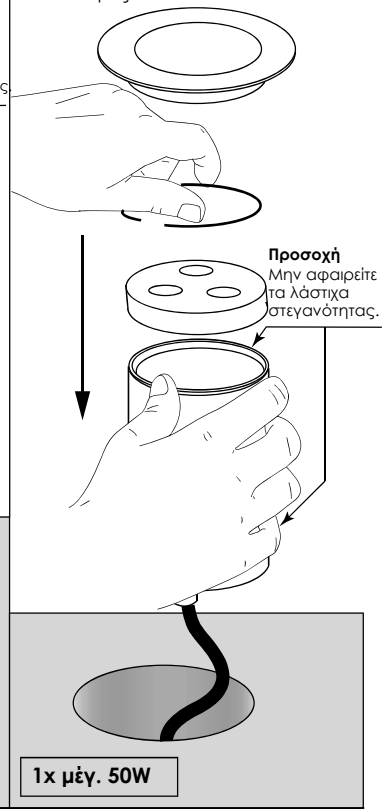

ΟΔΗΓΙΕΣ ΕΓΚΑΤΑΣΤΑΣΗΣ

- Η εγκατάσταση πρέπει να γίνεται από αδειούχο ηλεκτρολόγο.
- Εφόσον υπάρχει ακροδέκτης γείωσης, συνδέστε τον στη γείωση της εγκατάστασης.
- Βεβαιωθείτε ότι η παροχή είναι απενεργοποιημένη κατά τη συντήρηση.
- Η ισχύς των λαμπτήρων δεν πρέπει να υπερβαίνει την ένδειξη στο φωτιστικό ή στη συσκευασία.
- Μετά την εγκατάσταση ελέγξτε τη στερέωση και τη σύσφιξη των στυπιοθλιπτών, όπου υπάρχουν.
- Ο κατασκευαστής δεν ευθύνεται για τραυματισμούς ή ζημιές από λανθασμένη εγκατάσταση ή χρήση.
- Δεν προορίζεται για βρογχοειδή σύνδεση.
- Τα ούπα και οι κλέμες δεν περιλαμβάνονται.
- Τα στοιχεία LED αντικαθίστανται μόνο από τον κατασκευαστή.

ΠΡΟΣΟΧΗ
Φοράτε αντιστατικά γάντια όταν αγγίζετε τα LED.



ΠΡΟΣΟΧΗ
Αντικαταστήστε τυχόν ραγισμένο γυαλί.



BRIGHT ΕΙΔΙΚΟΣ ΦΩΤΙΣΜΟΣ

Εργοστάσιο
Κεφαλοβρύσου 5, Μονομάτι, Αχαρνές, Τ.Κ. 13677, Αθήνα, Ελλάδα Τηλ: (+30) 210 6208 230 |
E-mail: info@bright.gr | www.bright.gr

IP67


GREENLIGHT

MINI TERES 1 GROUND BRASS H.P.LED

JUL 2024

installation instructions


outdoor / ground

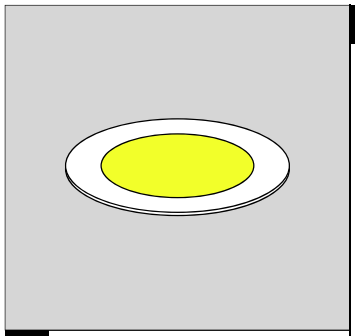


1 **Installation**
Unscrew and remove the base part.



2 Pass the cable through the cable gland. Make wiring connections.



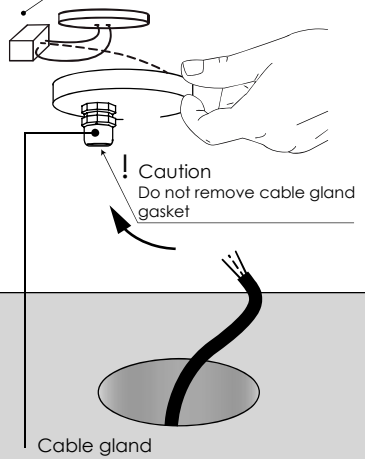


! Caution
Do not remove cable gland gasket

Cable gland
with ventillation membrane system



wrench No 17

3 Screw the base part and insert the luminaire into the ground.

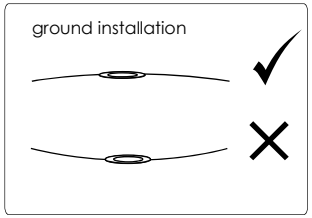




4 **Lamp replacement**
Unscrew and remove the cap of the luminaire.



5 Remove the holding spring.



6 Place the lamp and then the holding spring. Screw the cap and insert the luminaire in the ground.

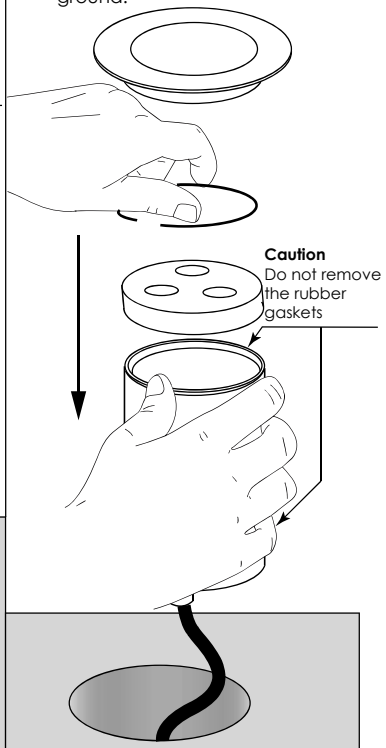

1x max 50W

USER INSTRUCTIONS
- The installation of the unit must be done by a qualified electrician.
- The unit must be earthed in case an earth connecting point exists.
- Ensure that the mains is switched off during servicing.
- Do not use bulb(s) bigger than the indicated on units name-plate or packaging.
- Ensure that after the installation, the unit is properly fixed and the cable clamps (if exist) are well tightened.
- Manufacturer will not accept liability for injury or damage resulting from incorrect use or installation
- The unit is not intended to operate in loop connection.
- Wall plugs and terminals are not included.
- LED modules are replaced only by the manufacturer.

CAUTION
Wear anti-static gloves
before you touch LED systems



CAUTION
Replace any cracked shield



BRIGHT SPECIAL LIGHTING

Factory
5 Kefalovrisou Str., Monomati, Acharnai, P.O. Box 13677, Athens, Greece
Tel: (+30) 210 6208 230 | E-mail: info@bright.gr | www.bright.gr

IP67

GREENLIGHT