DOUBLE LOUVRE SURGERY

INSTALLATION INSTRUCTIONS FOR LUMINAIRE DOUBLE LOUVRE SURGERY

1 A. Adjust on false ceiling (i)

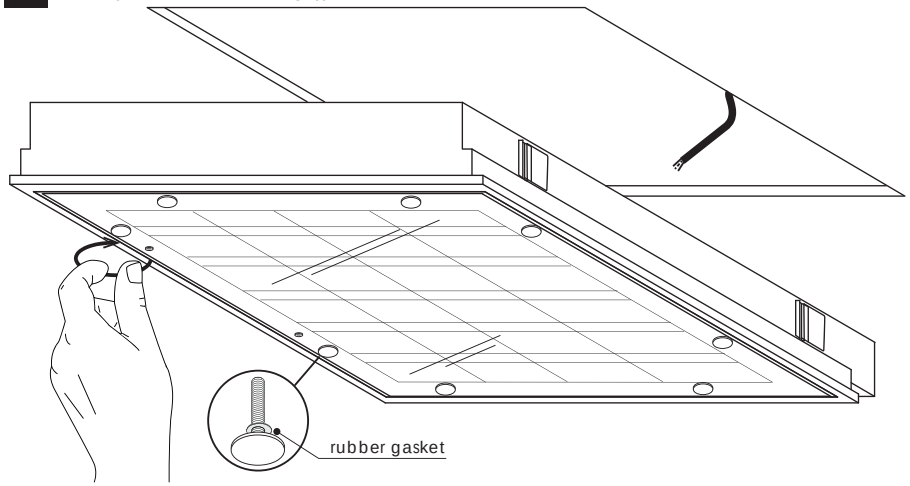

B. Loosen (8) screws to remove the glass cover and then remove the reflector

(i)

2

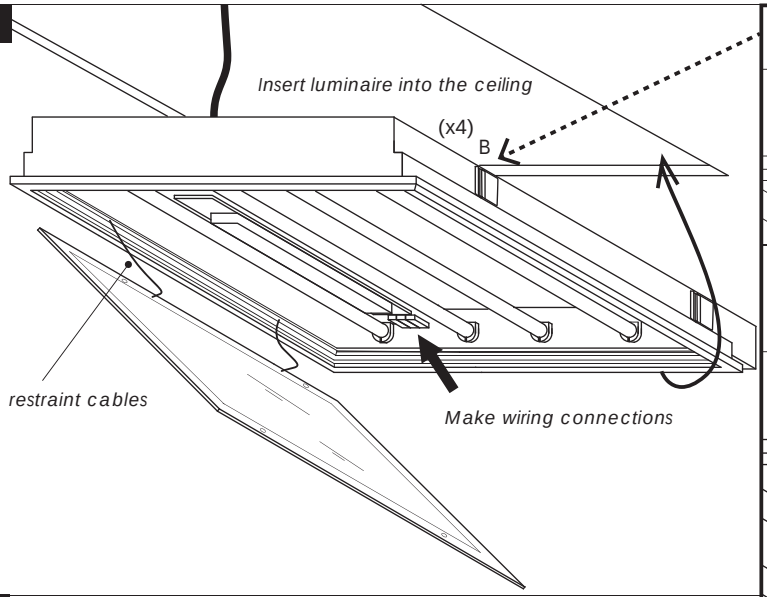

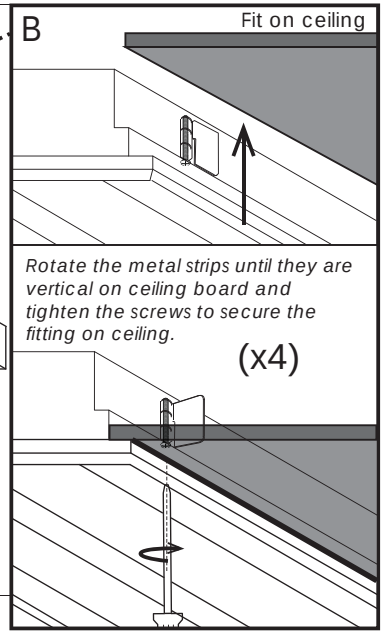

3

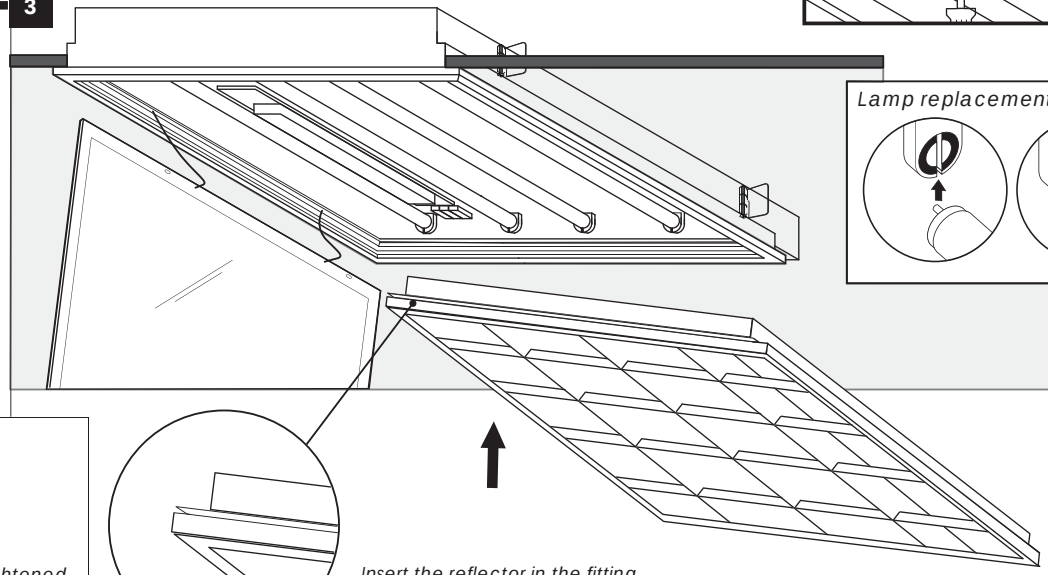

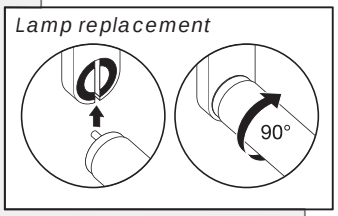



Insert the reflector in the fitting.
The reflector is restrained by its overhangs.

		cut dimensions (mm)	H (height)
D.Louvre Surgery / 4xT5	14W, 24W	580 x 580	150
D.Louvre Surgery / 4xT8	18W	580 x 580	
D.Louvre Surgery/ 2xT5	14W, 24W	280 x 580	
D.Louvre Surgery/ 2xT8	18W	280 x 580	
D.Louvre Surgery/ 2xT5	28W, 54W	280 x 1180	
D. Louvre Surgery / 4xT5	28W, 54W	580 x 1180	

USER INSTRUCTIONS

- *The installation of the unit must be done by a qualified electrician.*
- *The unit must be earthed in case an earth connecting point exists.*
- *Ensure that the mains is switched off during servicing.*
- *Do not use bulb(s) bigger than the indicated on units name-plate or packaging.*
- *Ensure that after the installation, the unit is properly fixed and the cable clamps (if exist) are well tightened.*
- *Manufacturer will not accept liability for injury or damage resulting from incorrect use or installation*
- *The unit is not intended to operate in loop connection.*
- *Wall plugs and terminals are not included.*
- *Degree of protection IP65 is achieved after luminaire is installed.*

Last updated: *October 2014*

BRIGHT SPECIAL LIGHTING

www.bright.gr

Factory: 5 Kefalovrisou Str., Monomati, Acharnai, P.O. Box 13677, Athens, Greece
Tel: (+30) 210 6208 230 Fax: (+30) 210 62 08 262

IP65

GREENLIGHT